


CERTIFICATE

Certified Passive House Component

Component-ID 1871wi04 valid until 31st December 2022

Passive House Institute
Dr. Wolfgang Feist
64283 Darmstadt
Germany

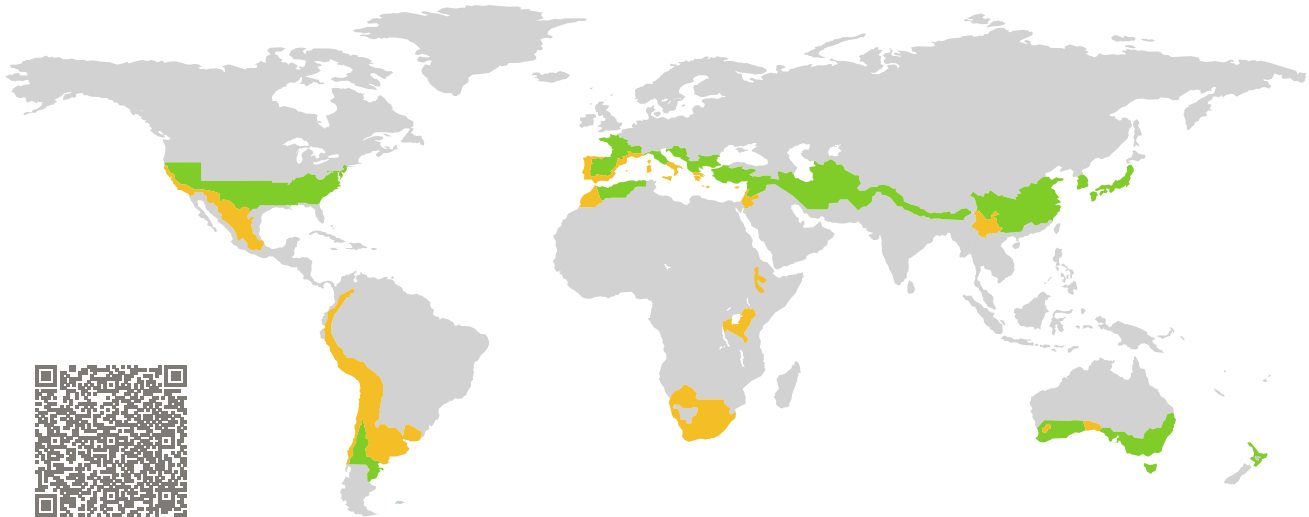


Category: **Window Frame**
Manufacturer: **Finesse Window Systems Australia PTY Ltd, Campbellfield, Australia**
Product name: **Finesse Passive 80 Tilt and Turn**

This certificate was awarded based on the following criteria for the warm, temperate climate zone

Comfort $U_W = 0.99 \leq 1.00 \text{ W}/(\text{m}^2 \text{ K})$
 $U_{W,\text{installed}} \leq 1.05 \text{ W}/(\text{m}^2 \text{ K})$
with $U_g = 0.90 \text{ W}/(\text{m}^2 \text{ K})$

Hygiene $f_{Rsi=0.25} \geq 0.65$

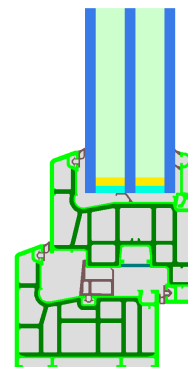

warm, temperate climate



ph C

CERTIFIED COMPONENT

Passive House Institute

Passive House efficiency class

phE


phD

phC

phB

phA

www.passivehouse.com

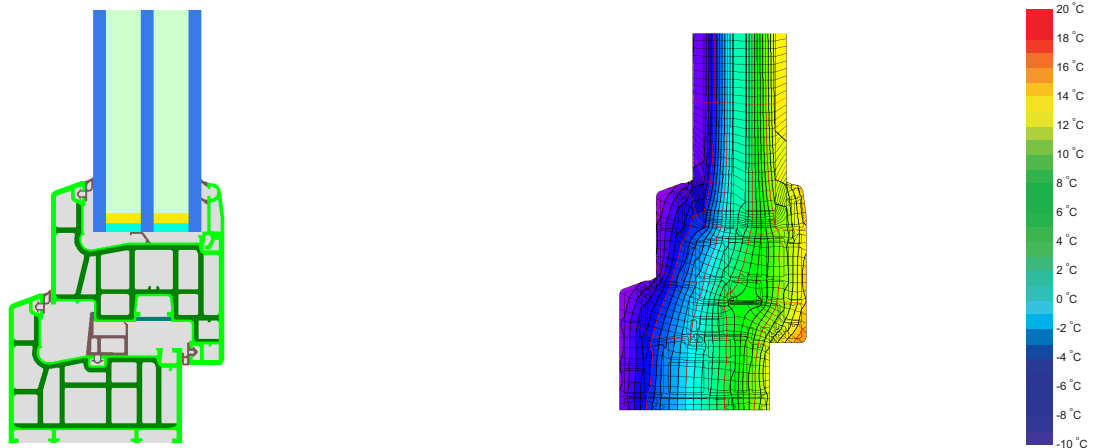

Calculation model

Isothermal

Description

Frame made of timber-PVC-composite and PVC; maximum size of window: 1.2m x 2.3m or 0.8m x 2.4m; Pane thickness: 50 mm (6/16/6/16/6), rebate depth: 23 mm. Spacer: SuperSpacer Premium with butyl as secondary seal.

Explanation

The window U-values were calculated for the test window size of 1.23 m × 1.48 m with $U_g = 0.90 \text{ W}/(\text{m}^2 \text{ K})$. If a higher quality glazing is used, the window U-values will improve as follows:

Glazing	$U_g =$	0.90	0.80	0.70	0.64	$\text{W}/(\text{m}^2 \text{ K})$
		↓	↓	↓	↓	
Window	$U_w =$	0.99	0.92	0.85	0.81	$\text{W}/(\text{m}^2 \text{ K})$

Transparent building components are classified into efficiency classes depending on the heat losses through the opaque part. The frame U-Values, frame widths, thermal bridges at the glazing edge, and the glazing edge lengths are included in these heat losses. A more detailed report of the calculations performed in the context of certification is available from the manufacturer.

The Passive House Institute has defined international component criteria for seven climate zones. In principle, components which have been certified for climate zones with higher requirements may also be used in climates with less stringent requirements. In a particular climate zone it may make sense to use a component of a higher thermal quality which has been certified for a climate zone with more stringent requirements.

Further information relating to certification can be found on www.passivehouse.com and passipedia.org.

Frame values			Frame width b_f mm	U -value frame U_f W/(m ² K)	Ψ -glazing edge Ψ_g W/(m K)	Temp. Factor $f_{Rsi=0.25}$ [-]
Transom 1 casement	(1T1)		146	0.92	0.024	0.72
Bottom	(OB1)		121	0.99	0.024	0.73
Top	(OH1)		121	0.99	0.024	0.73
Lateral	(OJ1)		121	0.99	0.024	0.73
			Spacer: Super Spacer® Premium		Secondary seal: Butyl	

Validated installations

